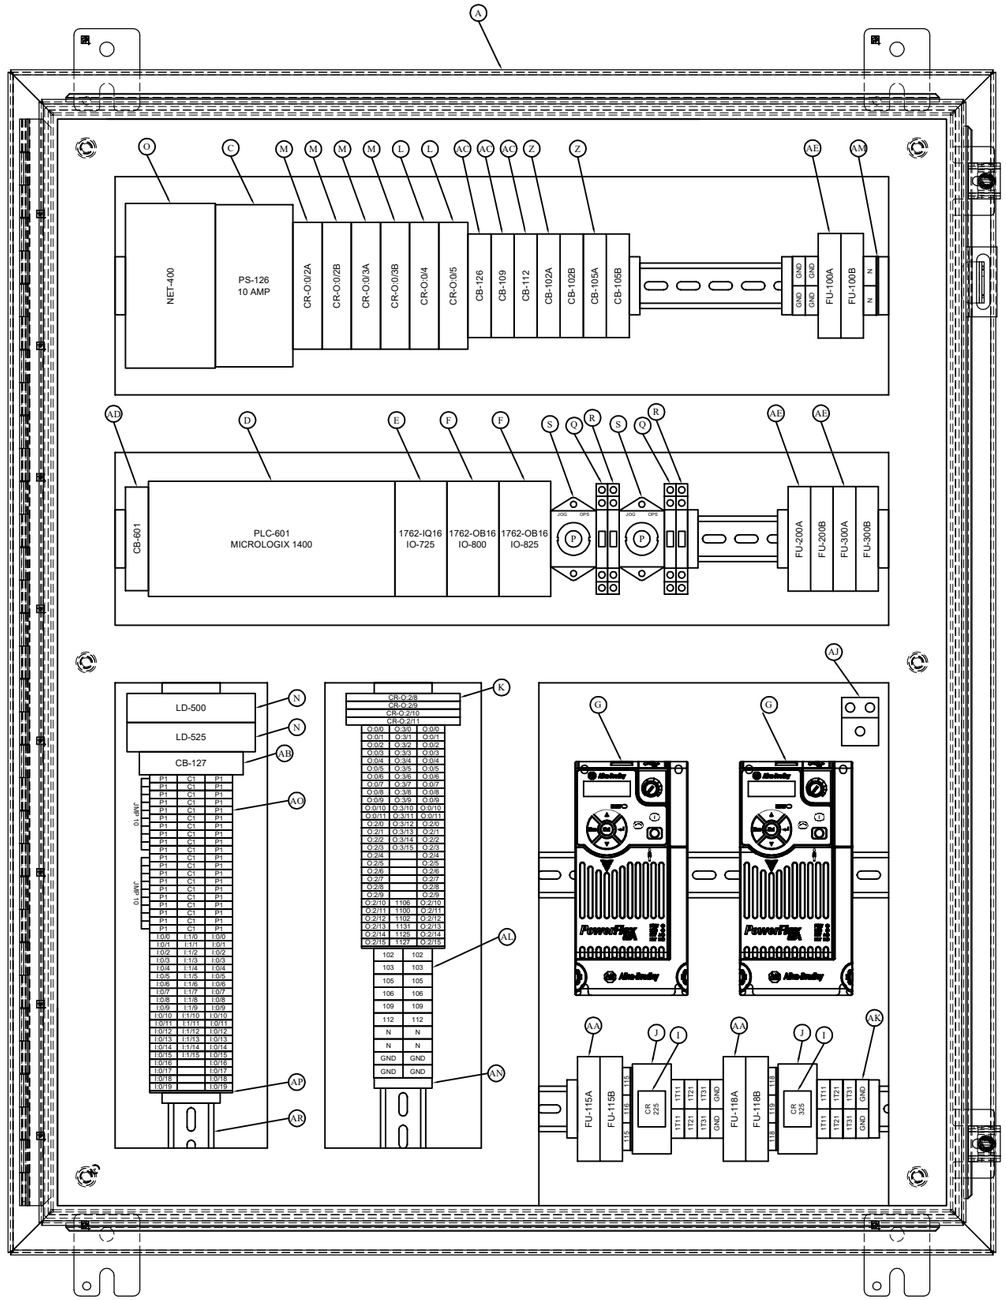

*** Concept Only ***

NOTE: ALL WIRE CONDUCTOR/CONDUIT SIZING/TYPE TO BE DETERMINED BY INSTALLER AND INSTALLED IN ACCORDANCE WITH NEC GUIDELINES, LOCAL ELECTRICAL CODES, AND ALL OTHER APPLICABLE CODES AND REGULATIONS.

REV #	BY	DATE	REVISIONS

Total Automation Group, Inc.

NAME: TAG SER 2, TWO LANE (TS2-2), GIBRALTAR 3 HP, EPU
208-240 VAC @ 60 Hz.
LAYOUT

DRAWN BY: SML | CHECKED: SML | SHEET: 1 of 2

PART NAME:

DATE: 08-18-17

DRAWING NUMBER: TAG-081817M001

SCALE: 1:1